



ULTRA FOG FIRE EXTINGUISHING SYSTEM VS. TRADITIONAL SPRINKLER SYSTEM




TABLE OF CONTENT

Introduction	03
01. About Traditional Sprinkler System	05
02. About Ultra Fog Fire Suppression System	06
03. Comparison	08
04. Conclusions.....	12

INTRODUCTION

Water has been very well known as a fire extinguishing agent for as long as man has used fire. Why is water so effective as a fire-suppression medium? Water has a very high specific heat capacity - it can hold more heat than any other everyday liquid- this is why it is used in central heating systems in our houses. Fire can only exist when there are sufficiently high levels of fuel, oxygen, and heat to sustain combustion. thereby enabling it to remove heat from the fire very effectively, thereby breaking what is known as the "fire triangle".


Automatic water sprinkler heads were commercially available since the mid 19th century, but the technology of high pressure water mist evolved in 1980s and 1990s. What was the reason behind this evolution? By comparing Traditional Sprinkler Systems and Ultra Fog Fire Suppression Systems, we will clarify the difference between both systems and explain the predominance of Ultra Fog Fire Suppression Systems.

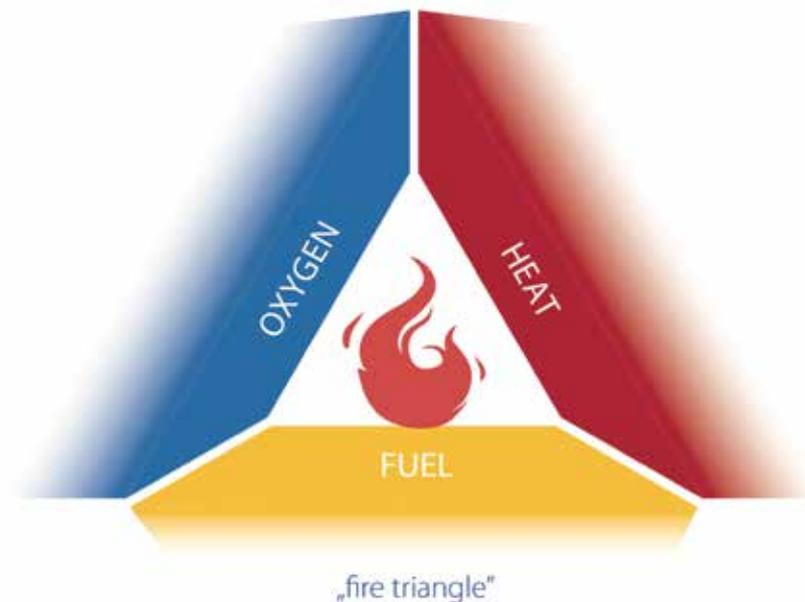


INTRODUCTION



Watermist Systems

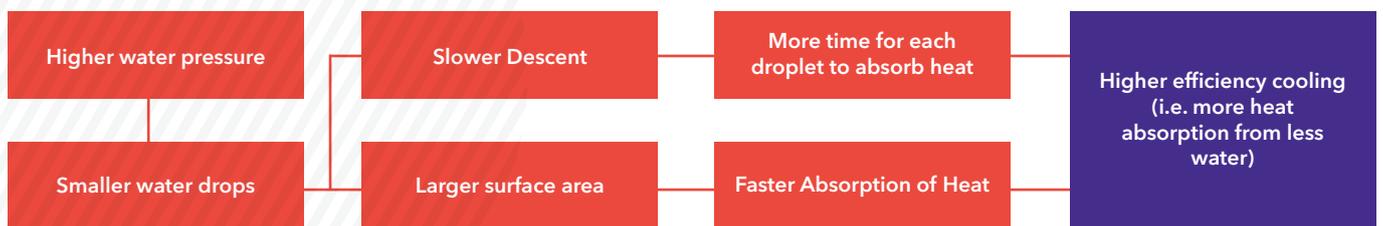


Sprinkler Systems

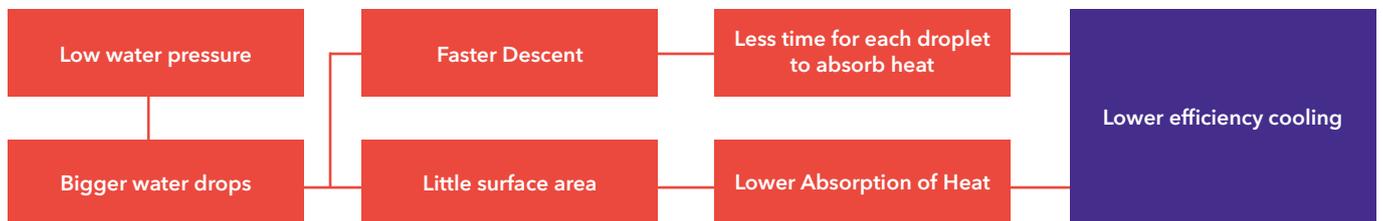

01. ABOUT TRADITIONAL SPRINKLER SYSTEM

Traditional Sprinkler Systems were available in commercial sale since the mid 19th century. They use water in order to perform, however the form of water distribution is different than for Ultra Fog Fire Suppression Systems.


Sprinkler sprays are composed of droplets. The number of droplets of each size depends on the sprinkler design, water pressure and location in the spray. In traditional sprinklers, the typical diameter of each droplet is 1mm or larger. At that size, 1 litre of water produces approximately 1.9 million droplets, having a total surface area of 6m².

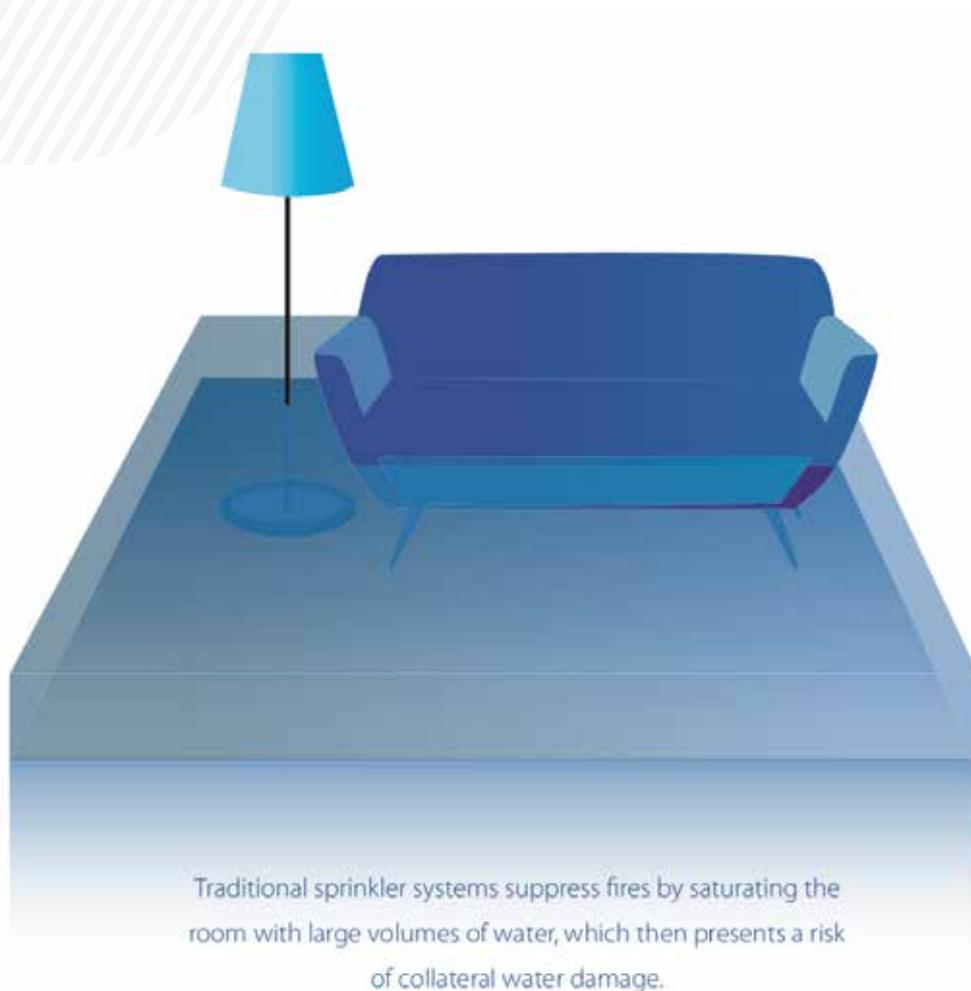

02. ABOUT ULTRA FOG FIRE SUPPRESSION SYSTEM


Ultra Fog water mist fire suppression systems provide robust, effective, quality engineered solutions for applications which require optimal fire suppression while minimising the volume of water consumed and deployed. High pressure pumps force water through the stainless steel Ultra Fog water mist nozzles, discharging the water in the form of millions of tiny droplets - typically 30 - 200 μm diameter. At that size, 1 litre of water produces approximately 4 billion droplets, having a total surface area of 75m².

An activated system creates a blanket of water mist droplets which maximise heat absorption from the fire, and subsequently displacing oxygen upon evaporation and expansion of the water mist as it converts to steam. Water mist systems are differentiated from sprinkler systems by mist's unique ability to present a much greater water surface area (enabling rapid heat absorption), combined with the mist's ability to remain suspended in the air for a much longer duration - thereby creating more exposure time for the heat absorption to take effect. This enables water mist systems to cool and suppress fire using considerably less water than sprinkler systems.

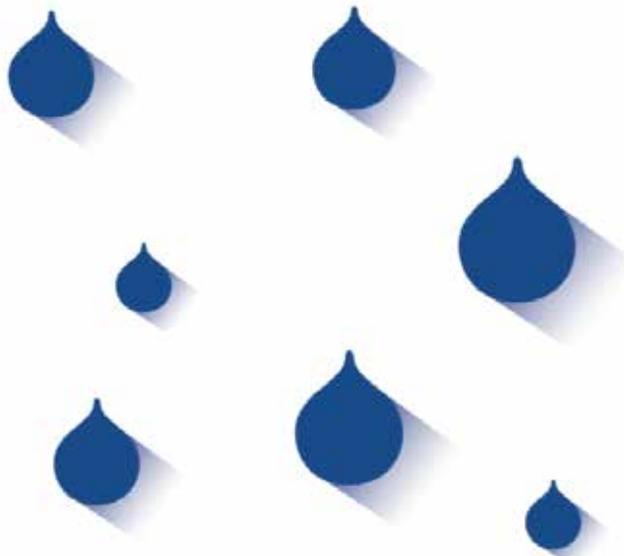

02. ABOUT ULTRA FOG FIRE SUPPRESSION SYSTEM

Water mist fire protection systems provide absolute protection for many kinds of enclosures. This occurs because the nebulised droplets, along with the oxygen present in the enclosure, affect the base of a fire. When the water mist turns into steam, it expands in volume by 1700x, thereby reducing the concentration of oxygen available to the flame. This process of evaporation is a consequence of the absorption of heat from the fire, thereby cooling the fire.

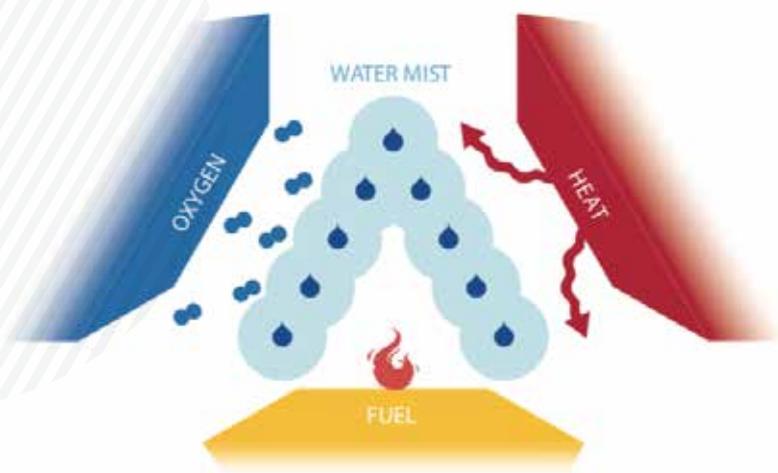

Watermist reduces two components of "Fire Triangle"
- fire is not able to exist without sufficient levels of Oxygen and Heat

The triangle-based formula for extinguishing fire also prevents from a probable re-ignition. The smaller droplets of watermist create a much larger surface area for interaction with the hot, toxic gases released during pyrolysis. To a certain extent the smoke is "scrubbed", and smoke damage within the room can be reduced.

Small pipe dimensions mean light weight and easy to install. High-performance stainless-steel nozzle can cover up to 48 square meters. Wider nozzle spacing means less labour and potentially lower installation costs. Further to this, the patented design of the Ultra Fog nozzle provides a unique ability to test the system without breaking the frangible glass bulb, using Ultra Fog's patented nozzle test tool.

03. COMPARISON

Water mist fire protection systems share many similarities with sprinkler systems. Both systems use water as the suppression medium, pumped through a network of pipes and zone valves, and deployed within the affected area via ceiling or wall-mounted heads. The main difference is the working pressure of each system. While sprinkler systems typically operate below 12 bar [175 psi], high-pressure water mist systems operate within the range of 35 - 120 bar [500-1740 psi]. Sprinkler systems typically work by drenching the surfaces of the fuel and surrounding surfaces; water mist systems work by rapid cooling of the fire via vaporisation of the water droplets into steam. The higher the pressure of the system; the smaller the diameter of the water droplets from each head. So, while a sprinkler system will produce droplets with a typical diameter of 1mm or more, ULTRA FOG® water mist systems produce water droplets with a typical diameter of 0.1mm. Why does this matter? The smaller the droplets, the faster the rate of heat transfer, and the quicker the cooling and suppression of the fire. Further to this, the smaller the droplet, the slower it falls from the ceiling to the floor. Thereby water must not only exchange heat more rapidly, but it also remains suspended in the air for longer and has more time to interact with the heat and smoke of the fire. This makes water mist highly efficient, to the extent that ULTRA FOG® water mist systems typically consume up to 90% less water than sprinkler systems.

Efficient use of water brings several benefits. A distinct advantage is the ability to use significantly smaller water tanks than sprinkler systems; and under certain jurisdictions, water mist systems' minimal water consumption may present an opportunity to connect the water mist system directly to the mains water supply thereby removing the need for a storage tank. This opens the possibility for the architect or main contractor to utilise the space for other purposes, for example: to re-allocate the space for other essential services; or for car parking spaces for the building's occupants.

03. COMPARISON

Lower water consumption also enables water mist systems the use smaller diameter distribution pipework compared with sprinkler systems. ULTRA FOG® water mist systems typically utilise 12mm, 22mm, 28mm, and 42mm outside diameter stainless steel pipework. This saves space within ceiling voids - which are often shared with and occupied by the building's HVAC, water main, drainage, lighting, communication, and power cable conduits. The use of small diameter pipe also simplifies the installation of the system and coordination of the pipework amongst the other services throughout the building. Pipes can be more easily cut, shaped, and handled onsite, without the need for extensive pre-fabrication.

Damage limitation is a further crucial advantage of water mist systems when compared with sprinkler systems. While the goal of both sprinkler systems and water mist systems is to suppress fire; their use within domestic, commercial, and industrial buildings can result in collateral, water damage. Sprinkler systems suppress fires by drenching the affected space with high volumes of water, to soak the fire's fuel and its adjacent surfaces. Water mist systems contain fires by creating a shroud of mist around the fire, to cool the air within the affected space, and to suppress the fire by removing heat from the fire's source. In addition to this, the exchange of heat from the fire to the mist causes expansion of the mist which displaces oxygen from the fire. Under laboratory test conditions, water mist systems typically deploy 10-20% of the water of an equivalent sprinkler system. In the real world, this translates as less water damage within the building and its valuable contents. For this reason, ULTRA FOG® water mist systems have been installed within a broad range of sensitive structures throughout the world - ranging from medieval buildings of significant cultural value; to highly secure, ultra-modern military facilities.

In light of these significant technical and commercial benefits, water mist systems are becoming more widely recognised as an alternative to sprinkler systems. National standards governing the testing, design, installation, and maintenance of water mist systems have been developed as a means of regulation within the industry. These include NFPA 750 (USA), CEN/TS 14972 (EU), NS-INSTA 900 (Norway), ISO 6182- 9 (international), and most recently BS 8458 & BS 8489 for residential, domestic, industrial, and commercial water mist systems within the UK.

The origins of the development of water mist systems for marine and off-shore applications in the late 1980s was spurred by Montreal Protocol which phased-out the production of halon, amid concerns of CFCs' detrimental effect on the ozone layer. Today, new environmental factors are driving demand for highly efficient water mist fire suppression systems.

03. COMPARISON

An example of this is within the residential sector, where there exists an ever-increasing need for housing; limited space to build; increasingly stringent energy efficiency targets; and an ever-present need to conserve water. Within urban environments, this is fuelling the rapid development of modern high rise buildings; the refurbishment of existing residential tower blocks; and in some cases, the redevelopment and change of use of office blocks into residential dwellings. While new-build high rise buildings are generally required to be equipped with an active fire suppression system; at present, most jurisdictions do not require sprinkler systems to be retroactively installed within older tower blocks constructed under superseded or obsolete regulations. In the absence of active fire suppression, life safety and damage limitation is reliant upon the concept of “compartmentation” – the containment of a fire within a dwelling, via the use of fire-resistant doors, partitions, and ceilings. Rigorous building control measures are necessary throughout the life of the building to ensure that any subsequent modification to the fabric of the building does not compromise the building’s fire stopping. The fire at Lakanal House, London in 2009 serves as a reminder of the fatal consequences of the breaching of passive fire-stopping, and the subsequent threat to life in the event of failure of compartmentation. Comprehensive inspection and assessment of the fire stopping throughout a building is often an impossible task, mainly as passive fire protection elements are usually concealed behind architraves, rendering, and other permanent, non-removable cosmetic finishes. As such, if building control is lacking during the construction and subsequent modification of the fabric of the building, defects within passive fire stopping can remain undetected for years. In contrast, sprinkler and water mist systems are engineered to detect particular faults automatically, and these systems are designed to enable rapid fault diagnosis within a regular schedule of basic maintenance and inspection.

Historically, sprinkler systems may have been the only option for architects, consultants, and main contractors for particular projects. The relatively recent formal recognition, standardisation, and acceptance of water mist systems for land-based applications opens new possibilities and offers the potential for both technical and commercial benefits when compared with sprinkler systems. In summary: water mist systems provide the potential for smaller pump units, less pipework, smaller pipe diameters, fewer heads, smaller water tanks, less water consumption, and lower running costs than that of sprinkler systems.

As the environmental, technical, and social challenges of global fire safety evolve; ULTRA FOG® continues to build upon its 30 years’ experience of the research, development, and manufacturing of highly reliable water mist fire suppression systems and remains at the forefront of this life-saving technology.

03. COMPARISON



Ultra Fog
Fire Suppression System

3 - dimensional area of coverage - water mist penetrates areas easier than traditional sprinkler system. Droplets suspended in the air can fill the entire volume of the room.

80 - 90% less water used in comparison to the traditional sprinkler system.

Nozzles can be tested without breaking frangible glass bulb. Test may be performed by any competent person, as Ultra Fog Test Tool is easy to use.

Water mist system installed on the right height, cools the fire.

It is common to use water mist system in switchboard rooms and data centers.



Traditional
Sprinkler System

Bigger drops are only covering area below traditional sprinkler, not penetrating other areas.

Traditional Sprinkler Systems use more water than the Ultra Fog Fire Extinguishing System.

You can't test the nozzles without breaking the glass bulb. Testing traditional nozzles consumes more time and expense.

Bigger water drops used in traditional sprinkler systems may displace the pool and cause fire spread.

Traditional sprinkler systems are not being used with sensitive electrical applications.



Area of Coverage



Water Usage



Testing



Liquid pool fires



Sensitive electrical applications

CONTACT US



trading@sibca.com

UNITED ARAB EMIRATES

ABU DHABI - HEAD OFFICE

P.O. Box 46944, Abu Dhabi, UAE
SIBCA Building
Behind Etisalat T & A Building
Quba Street - Khalidya
Tel: +971 2 497 8600
Fax: +971 2 497 8700
Email: info@sibca.com

AL AIN

P.O. Box 19318, Al Ain, UAE
403, Building No. 43, Oud Al Touba Street
Tel: +971 3 751 8080
Fax: +971 3 751 9280
Email: info@sibca.com

DUBAI

P.O. Box 55472, Dubai, UAE
2nd Floor, Vision Tower, Business Bay.
Tel: +971 4 381 9444
Fax: +971 4 381 9445
Email: info@sibca.com

SHARJAH

P.O.Box 5608, Sharjah, UAE
1004, Al Mulla Tower, Al Nahda.
Tel: +971 6 502 8555
Fax: +971 6 502 8500
Email: sibca.shj@sibca.com

AJMAN

P.O. Box 22563 , Ajman, UAE
1901, D Block, Horizon Tower
Tel: +971 6 538 2117
Email: sibca.ajm@sibca.com

UMM AL QUWAIN

P.O. Box 5608, Uaq, UAE
2, Malik Faisal Road
Tel: +971 6 539 5879
Email: sibca.uaq@sibca.com

RAS AL KHAIMAH

P.O. Box 12480, Rak, UAE
Al Oraibi, Al Rams Road, Ras Al Khaimah, UAE
Tel: +971 7 236 1003
Fax: +971 7 228 0445
Email: sibca.rak@sibca.com

FUJAIRAH

P.O. Box 22563, Fujairah, UAE
1001, Emirates Islamic Bank Building
Tel: +971 9 222 1816
Email: sibca.fuj@sibca.com

KINGDOM OF BAHRAIN

MANAMA

P.O. Box 5703
Office 12, MSCEB Bldg. 123, Road 402,
Manama 304, Kingdom of Bahrain
Tel: +973 172 12639
Fax: +973 172 12638
Email: info@sibca.com

INDIA

**Lumiere, Sasthamangalam,
Thiruvananthapuram, Kerala**



Customer Support : 800 - SIBCA (74222)
www.sibca.com

04. CONCLUSIONS

Traditional sprinkler systems and Ultra Fog watermist system are both proven fire suppression technologies. The method by which they suppress fire is slightly different. Sprinkler systems use large volumes of water to wet the surface of the fuel. Watermist systems use smaller volumes of water primarily to cool the hot, flammable gases which are released from the fuel as a result of pyrolysis.

Better efficiency and shorter time needed to extinguish helps to reduce amount of toxic gases produced during the fire. Less amount of water used during putting out a fire contributes to less damage. Compared to sprinkler systems, our system is a sustainable way of fire protection: require only very small quantities of water and power, it is environmentally friendly, does not harm humans, doesn't contribute to global warming, is lightweight, and reliable. Additionally, it is possible to test the nozzles without causing any harm on the system, thanks to the dedicated test tool.